

Sample Received: June 1, 2026

COA Issued: June 17, 2026

PRODUCT INFORMATION


Vendor:	Sample Name:	Sample Type:	Lot Number:	MW (g/mol):
EndoBiopeptides	Semax 10mg	White lyophilized powder	XA10	813.9

ANALYTICAL METHODS

Identity: Confirmed via MALDI-MS
Purity: RP-HPLC (214 nm)
Content: HPLC quantitation

TEST RESULTS

Specification	Result	Method	Status
Identity: Semax	Semax	MALDI MS	✓ Conforms
Content	10.68 mg	HPLC Quantitation	✓ Conforms
Overall Purity	99.9%	RP-HPLC (214 nm)	✓ Conforms
Sterility	Not Detected	<USP71>	✓ Conforms
Heavy Metals	<0.01ppm	<USP232>	✓ Conforms
Endotoxin	<0.05 EU/mL	<USP85>	✓ Conforms

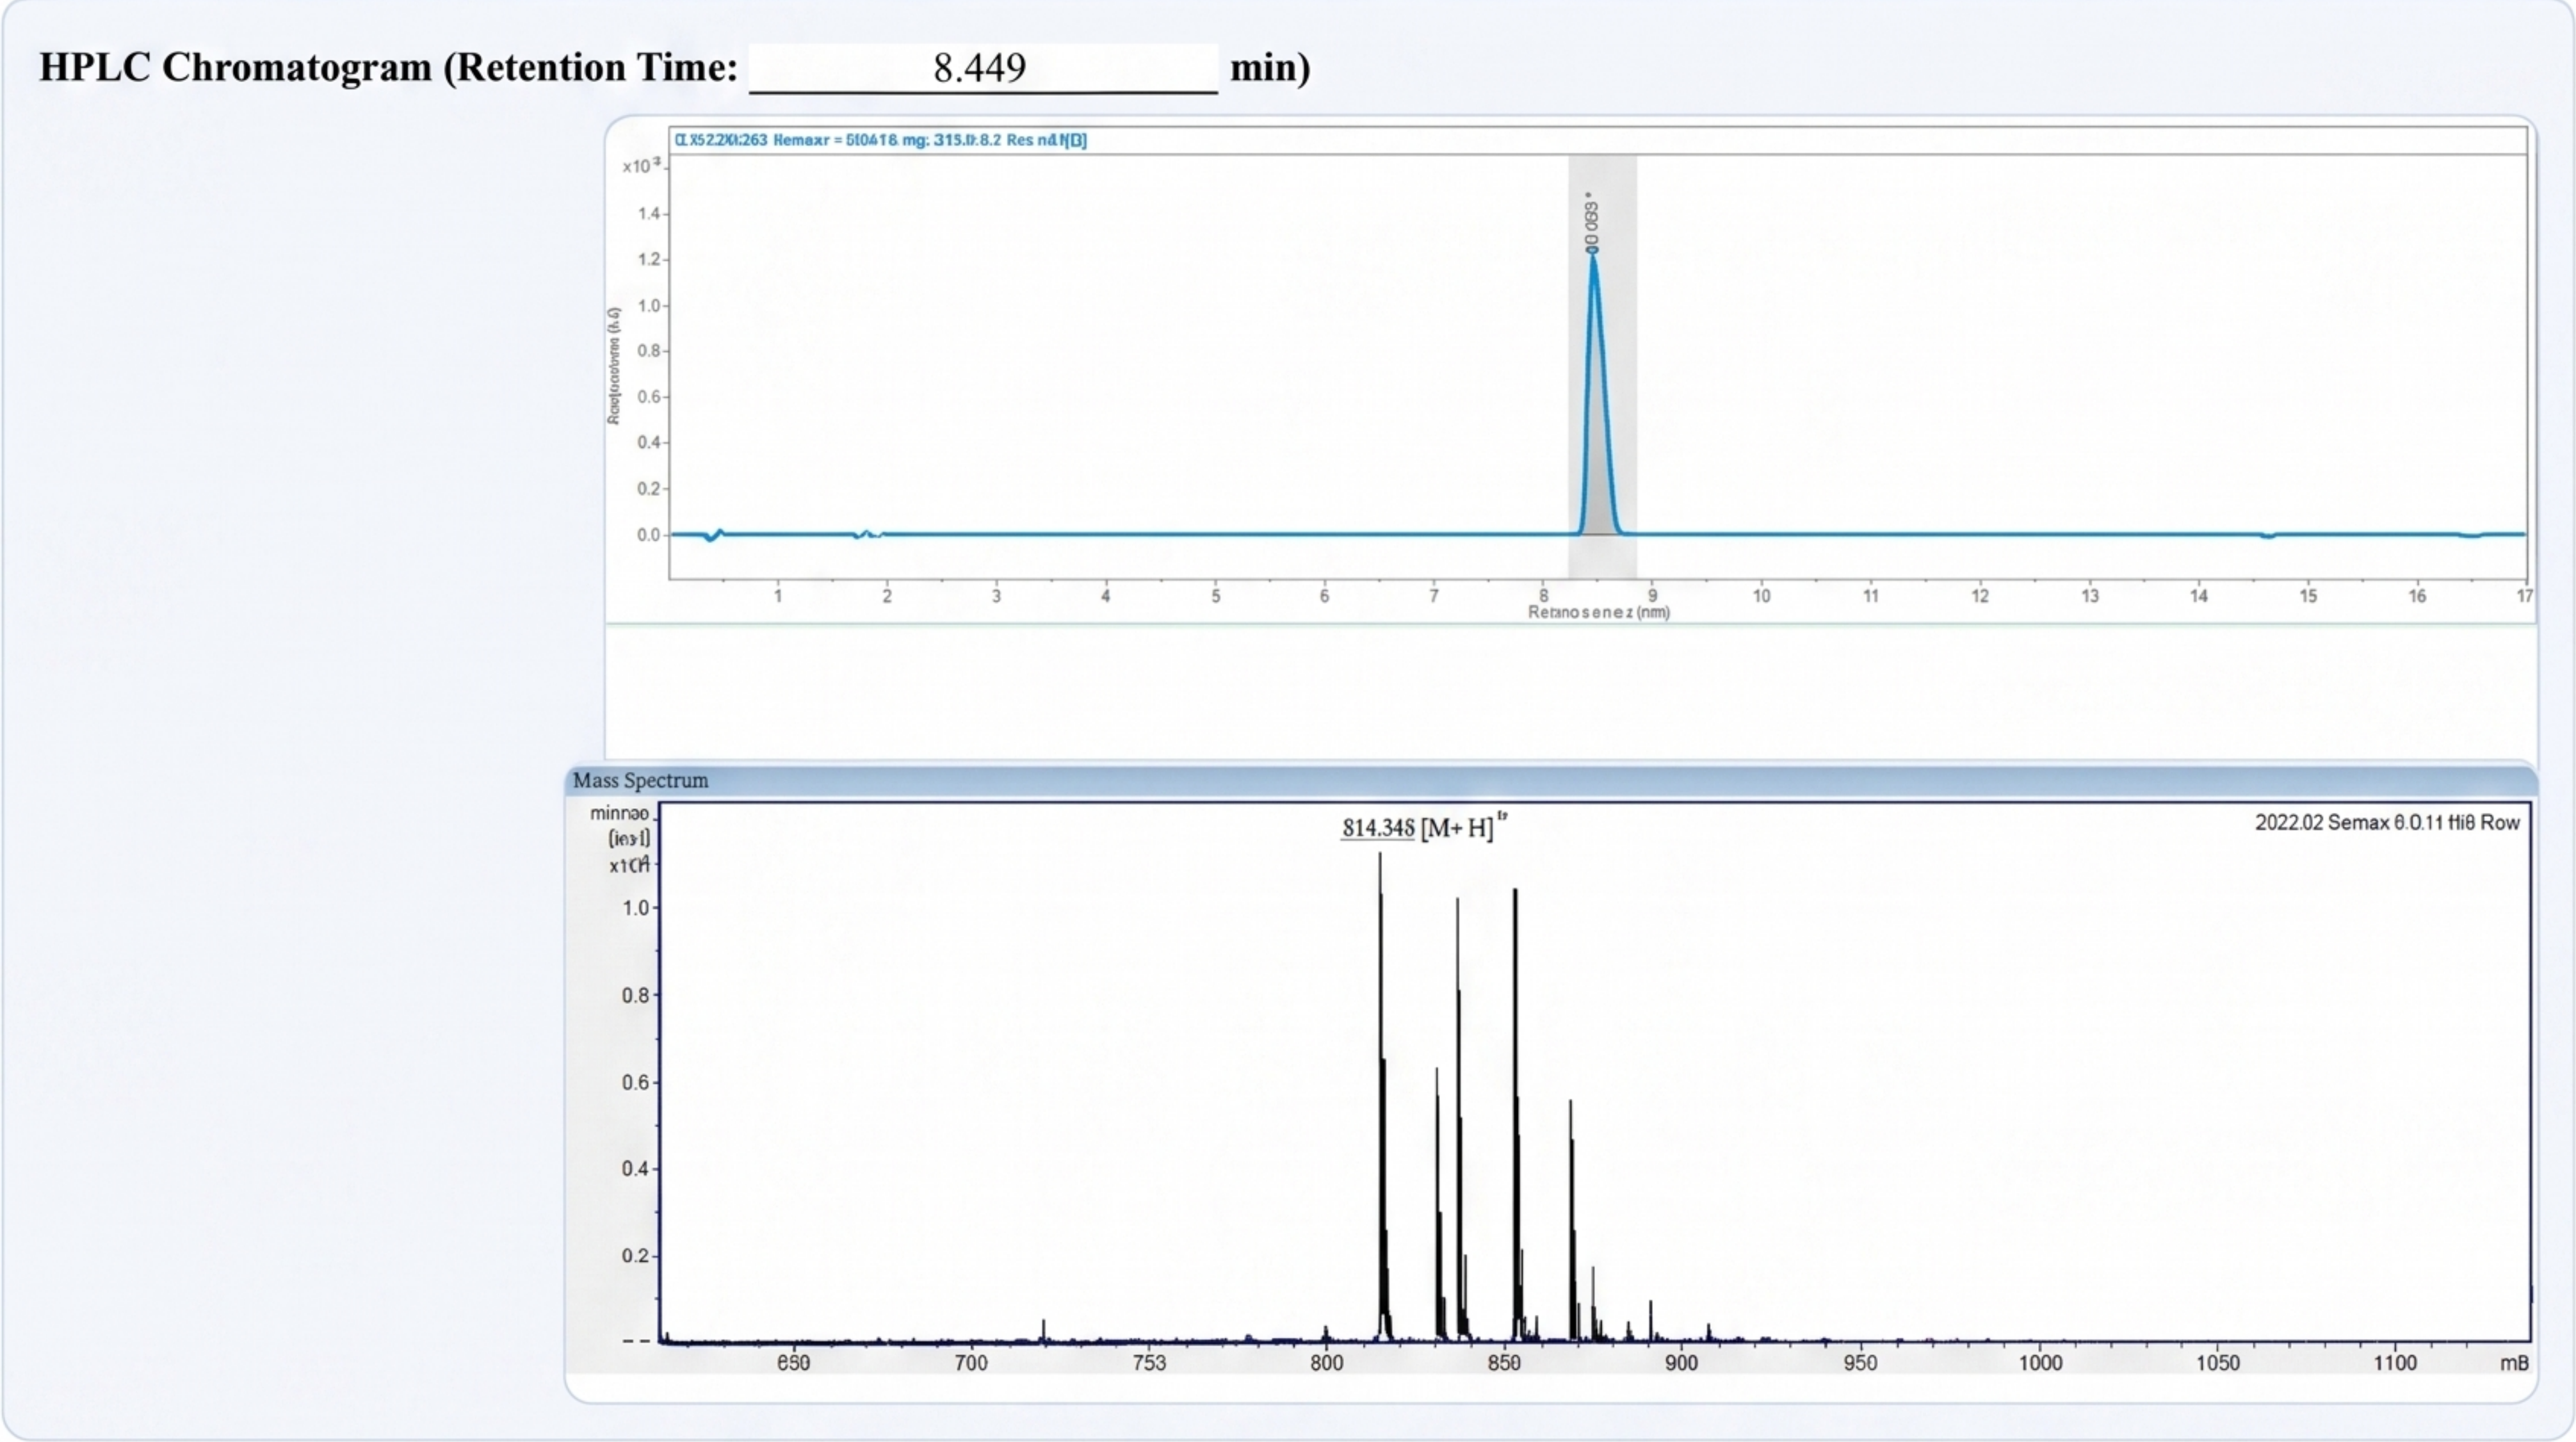

Certification:This COA confirms that the tested material meets or exceeds WEIPU’S analytical quality specifications for peptide research use.